

# **Product Specification**

# SenseAir® S8 LP

Miniature infrared CO<sub>2</sub> sensor module





Item	SenseAir® S8 LP Article no. 004-0-0053	
Target gas	CO <sub>2</sub>	
Operating Principle	Non-dispersive infrared (NDIR)	
Measurement range	400 to 2000 ppm (Note 1). 0 to 10000 ppm extended range (Note 2)	
Measurement interval	4 seconds	
Accuracy	±40ppm ±3% of reading (Notes 3 and 4)	
Pressure dependence	+ 1.6 % reading per kPa deviation from normal pressure	
Response time	2 minutes by 90%	
Operating temperature	0 to 50° C	
Operating humidity	0 to 85% RH non condensed	
Storage temperature	-40 to +70 C	
Dimensions	33.5 x 20 x 8.5 mm (max dimensions)	
Weight	< 8 grams	
Power supply	4.5 V to 5.25 V unprotected against surges and reverse connection	
Power consumption	300 mA peak, < 18 mA average.	
Life expectancy	15+ years	
Compliance with	Emission: EN 61000-6-3:2007, EN 61000-6-4:2007 Immunity: EN 61000-6-1:2007 RoHS directive 2011/65/EU	
Serial communication	UART, Modbus protocol (Note 5). Direction control pin for direct connection to RS485 receiver integrated circuit.	
Alarm output, Open Collector	Alarm state open  1000/800 ppm Normal state is conducting max 100 mA. Transistor open at CO <sub>2</sub> High, OR Power Low, OR at Sensor Failure	
PWM output, 1 kHz	0 to 100% duty cycle for 0 to 2000 ppm 3.3V push-pull CMOS output, unprotected	
Maintenance	Maintenance-free for normal indoor applications with SenseAir® ABC on.	

Table 1. Key technical specification for the SenseAir® S8 LP

\_\_\_\_\_

- Note 1: Sensor is designed to measure in the range 400 to 2000 ppm with specified in the table accuracy. Nevertheless exposure to concentrations below 400 ppm may result in incorrect operation of ABC algorithm and shall be avoided for model with ABC on.
- Note 2: Sensor provides readings via UART in the extended range but the accuracy is degraded compared to specification in the table one.
- Note 3: In normal IAQ applications. Accuracy is defined after minimum 3 weeks of continuous operation with ABC. However, some industrial applications do require maintenance. Please, contact SenseAir for further information!
- Note 4: Accuracy is specified at room temperature +25°C and at normal pressure 101.3 kPa. Specification is referenced to certified calibration mixtures. Uncertainty of calibration gas mixtures (+-1% currently) is to be added to the specified accuracy for absolute measurements.
- Note 5: See specification (Modbus on SenseAir\_R\_S8 rev\_P11\_1\_00.doc preliminary specification)



#### **Absolute maximum ratings**

Stress greater than those listed in Table 2 may cause permanent damage to the device. These ratings are stress ratings only. Operation of the device at any condition outside those indicated in the operational section of these specifications is not implied. Exposure to absolute maximum rating for extended periods may affect device reliability.

Parameter	Minimum	Maximum	Units	Notes
Ambient temperature under bias	- 40	85	С	
Voltage on G+ pin with respect to G0 pin	- 0.3	5.5	V	1, 2
Maximum output current from active output pin	- 25	+ 25	mA	1
Maximum current on input	- 5	+ 5	uA	1
Maximum voltage on UART lines, PWM and bCAL_in	- 0.3	DVCC_out +	V	1
Maximum voltage on Alarm_OC	- 0.3	12	V	1,3

Table 2. Absolute maximum ratings specification for the SenseAir® S8 LP

Note 1: Specified parameter relies on specification of subcontractor and is not tested by SenseAir

Note 2: Refer chapter "Terminal Description" for rated voltage information

Note 3: Alarm\_OC pin is internally pulled up to G+. External pull up to higher voltage will provide resistive divider

powering sensor via high resistance.

#### Sample gas diffusion area

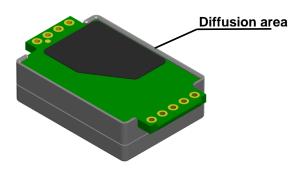


Figure 2. Diffusion area

### Pin assignment



Figure 3. Pin assignment



## **Terminals description**

The table below specifies terminals and I/O options dedicated in SenseAir® S8 LP model.

Pin Function	Pin description / Parameter description	Electrical specification	
Power pins			
G0	Power supply minus terminal Sensor's reference (ground) terminal		
G+ referred to G0	Power supply plus terminal	Unprotected against reverse connection!	
	Operating voltage range	4.5 V to 5.25 V	
DVCC_out	from sensor's voltage regulator Output may be used to logical level converter if master processor runs at 5V supply voltage.	Induced noise or excessive current drawn may affect sensor performance. External series resistor is strongly recommended if this pin is used	
	Series resistance	No internal protection!	
	Nominal voltage	3.3 VDC	
	Allowed source current	6 mA max	
	Voltage precision (Note 1)	± 0.75% is typical, ± 3% is max	
Communication p	ins		
UART_TxD	UART data transmission line Configured as digital output	No internal protection Pulled up to DVCC_out at processor reset (power up and power down)	
	Absolute max voltage range (Note 1)	G0 - 0.3V to DVCC_out + 0.5V	
	Internal pull up to DVCC_out resistor	120k	
	Output low level (Note 1)	0.75 VDC max at 10mA sink	
	Output high level (Note 1)	2.4 VDC at 2mA source	
UART_RxD	UART data receive line Configured as digital input	No internal protection Pulled up to DVCC_out at processor reset (power up and power down)	
	Absolute max voltage range(Note 1)	G0 - 0.3V to DVCC_out + 0.5V	
	Internal pull up to DVCC_out resistor	120k	
	Input low level (Note 1)	- 0.3V to 0.75V	
	Input high level (Note 1)	2.3V to DVCC_out + 0.3V	
UART_R/T	Direction control line for half duplex RS485 transceiver like MAX485. Configured as digital output	No internal protection, Pulled down at processor reset (power up and power down)	
	Absolute max voltage range(Note 1)	G0 - 0.3V to DVCC_out + 0.5V	
	Internal pull down to G0 resistor	120k	
	Output low level (Note 1)	0.75 VDC max at 10mA sink	
	Output high level (Note 1)	2.4 VDC at 2mA source	

Table 3. I/O notations, description and electrical specification (continued on next page)



Pin Function	Pin description / Parameter description	Electrical specification
Input / output		
bCAL_in/ CAL	Digital input forcing background calibration. Configured as digital input (when closed for minimum 4, max 8 seconds) bCAL (background calibration) assuming 400 ppm CO2 sensor exposure	No internal protection, Pulled up to DVCC_out at processor reset (power up and power down)
	Zero calibration (when closed for minimum 16 seconds) CAL (zero calibration) assuming 0 ppm CO2 sensor exposure	
	Absolute max voltage range(Note 1)	G0 - 0.3V to DVCC_out + 0.5V
	Internal pull up to DVCC_out resistor	120k
	Input low level (Note 1)	- 0.3V to 0.75V
	Input high level (Note 1)	2.3V to DVCC_out + 0.3V
PWM 1 kHz	PWM output Configured as digital output	No internal protection, Pulled down at processor reset (power up and power down)
	Used for direct reading by customer's microcontroller or to provide analog output. Refer "Use scenario suggestion" for details and ideas	
	Duty cycle min	0%, output Low
	Duty cycle max	100%, output High
	PWM resolution	0.5us ± 4%
	PWM period	1ms ± 4%
	Absolute max voltage range (Note 1) Internal pull down do G0 resistor	G0 - 0.3V to DVCC_out + 0.5V 120k
	Output low level (Note 1)	0.75 VDC max at 10mA sink
	Output high level (Note 1)	2.4 VDC at 2mA source
Alarm_OC	Open Collector output for alarm indication	No internal protection, Pulled up to G+ at processor reset (power up and power down)
	Absolute max voltage range(Note 1)	G0 - 0.3V to 5.5V
	Internal pull up to G+ resistor	120k
	Max sink current (Note 1)	100 mA
	Saturation voltage (Note 1)	2.3V to DVCC_out+0.3V

Table 3. I/O notations, description and electrical specification (continue, see previous page).

Note 1: Specified parameter relies on specification of subcontractor and is not tested by SenseAir



#### **Mechanical properties**

Please refer to mechanical drawing for detailed specification of dimensions and tolerances. See Handling manual for S8 (ANO102).

#### Installation and soldering

See Handling manual for S8 (ANO102).

#### **Maintenance and ABC (Automatic Baseline Correction)**

The models based on *SenseAir* <sup>®</sup> *S8 LP* platform are basically maintenance free in normal environments thanks to the built-in self-correcting *ABC* algorithm. This algorithm constantly keeps track of the sensor's lowest reading over preconfigured time interval and slowly corrects for any long-term drift detected as compared to the expected fresh air value of 400ppm (or 0.04%<sub>vol</sub>) CO<sub>2</sub>.

Discuss your application with SenseAir in order to get advice for a proper calibration strategy.

When checking the sensor accuracy, <u>PLEASE NOTE</u> that the sensor accuracy is defined at continuous operation (at least 25 days after installation with ABC turned on)!

ABC parameter	Specification
ABC period	8 days

Table 4. ABC default configuration for SenseAir® S8 LP

#### Calibration

Rough handling and transportation might result in a reduction of sensor reading accuracy. With time, the ABC function will tune the readings back to the correct numbers. The default "tuning speed" is however limited to about 30-50 ppm/week.

For post calibration convenience, in the event that one cannot wait for the ABC algorithm to compensate for possible calibration offset two manual calibration procedures are offered. A switch input is defined for the operator or master system to select one of the two prepared calibration codes. Optional calibrations are **bCAL** (background calibration), which requires that the sensor is exposed to fresh air (400 ppm  $CO_2$ ) and **CAL** (zero calibration), which requires the sensor measuring cell to be completely evacuated from  $CO_2$  e.g. by exposing it to Nitrogen or Soda Lime  $CO_2$  scrubbed air. Make sure that the sensor environment is steady and calm!

Input	Default function
bCAL_in	(when closed for minimum 4, max 8 seconds) bCAL (background calibration) assuming 400 ppm CO <sub>2</sub> sensor exposure
CAL_in	(when closed for minimum 16 seconds) CAL (zero calibration) assuming 0 ppm CO <sub>2</sub> sensor exposure

Table 5. Switch input default configurations for SenseAir® S8 LP



#### **Self-diagnostics**

The system contains complete self-diagnostic procedures. A full system test is executed automatically every time the power is turned on. In addition, constantly during operation, the sensor probes are checked against failure by checking the valid dynamic measurement ranges. All EEPROM updates, initiated by the sensor itself, as well as by external connections, are checked by subsequent memory read back and data comparisons. These different system checks return error bytes to the system RAM. The full error codes are available from the UART port communication. *Out of Range* error is the only bit that is reset automatically after return to normal state. All other error bits have to be reset after return to normal by UART overwrite, or by power off/on.

#### Error code and action plan

(Error code can be read via UART communication port)

Bit #	Error code	Error description	Suggested action
0	1	Fatal Error	Try to restart sensor by power OFF/ON. Contact local distributor.
1	2	Reserved	
2	4	Algorithm Error. Indicate wrong configuration.	Try to restart sensor by power OFF/ON. Check detailed settings and configuration with software tools. Contact local distributor.
3	8	Output Error Detected errors during output signals calculation and generation.	Check connections and loads of outputs. Check detailed status of outputs with software tools.
4	16	Self-Diagnostic Error.  May indicate the need of zero calibration or sensor replacement.	Check detailed self-diagnostic status with software tools. Contact local distributor.
5	32	Out of Range Error Accompanies most of other errors. Can also indicate overload or failures of sensors and inputs.  Resets automatically after source of error disappearance.	Try sensor in fresh air. Perform CO <sub>2</sub> background calibration. Check detailed status of measurements with software tools. See Note 1!
6	64	Memory Error Error during memory operations.	Check detailed settings and configuration with software tools.
7	128	Reserved	

Table 6. Error codes for SenseAir® S8 LP

**Note 1**. Any probe is out of range. Occurs, for instance, during over-exposure of  $CO_2$  sensor, in which case the error code will automatically reset when the measurement values return to normal. Could also indicate the need of zero point calibration. If the  $CO_2$  readings are normal, and still the error code remains, any other sensor probe mounted (if any) can be defect, or the connection to this probe is broken.

**Please note**: If several errors are detected at the same time the different error code numbers will be added together into one combined error code!





#### Contact

#### SenseAir® AB Europe

Box 96 Stationsgatan 12 SE- 82060 Delsbo Sweden

Phone: +46 (0) 653 - 71 77 70 E-mail: info@senseair.com Web site: senseair.com

#### SenseAir® North America

29030 SW Town Center Loop East Suite 202 #169 Wilsonville, OR 97070 USA

Phone: +1 (520) 349-7686 E-mail: infoamerica@senseair.com Web site: senseair.com

#### SenseAir® Asia

SenseAir® Chengdu Gas Sensors Ltd. First floor of 8th of Xingke South Road Jiniu High-Tech, Industrial Park 610036, Chengdu China

Phone: +86 - 028 875 928 85 E-mail: info@senseair.asia Web site: senseair.asia